


PROCESS FLOW DIAGRAM  
APPLICATION OF CLEARANCE FOR DIRECT CONNECTION TO THE GRID

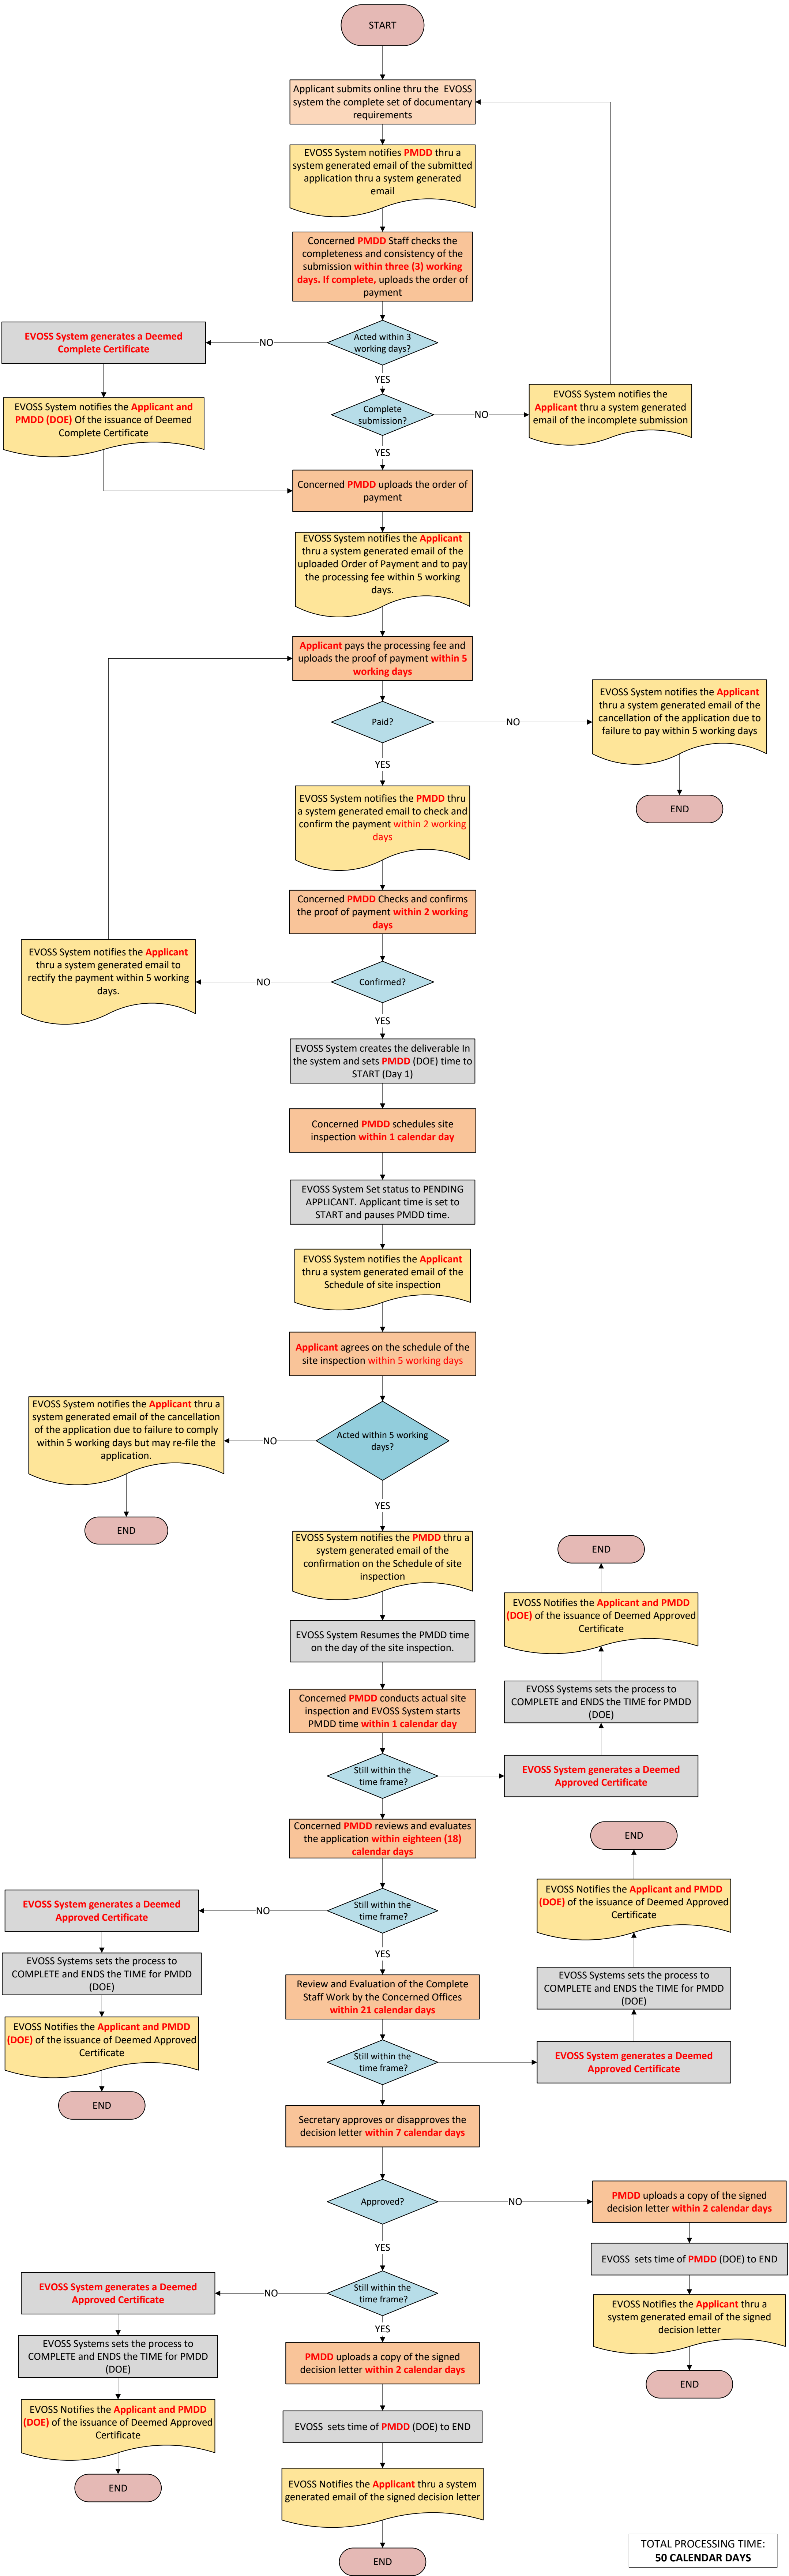

TOTAL PROCESSING TIME:  
50 CALENDAR DAYS