


PROCESS FLOW DIAGRAM
CLEARANCE TO UNDERTAKE SYSTEM IMPACT STUDY
TO THE NATIONAL GRID CORPORATION OF THE PHILIPPINES (NGCP)

NOTE : For coal power projects, it must satisfy the requirements of coal moratorium advisory

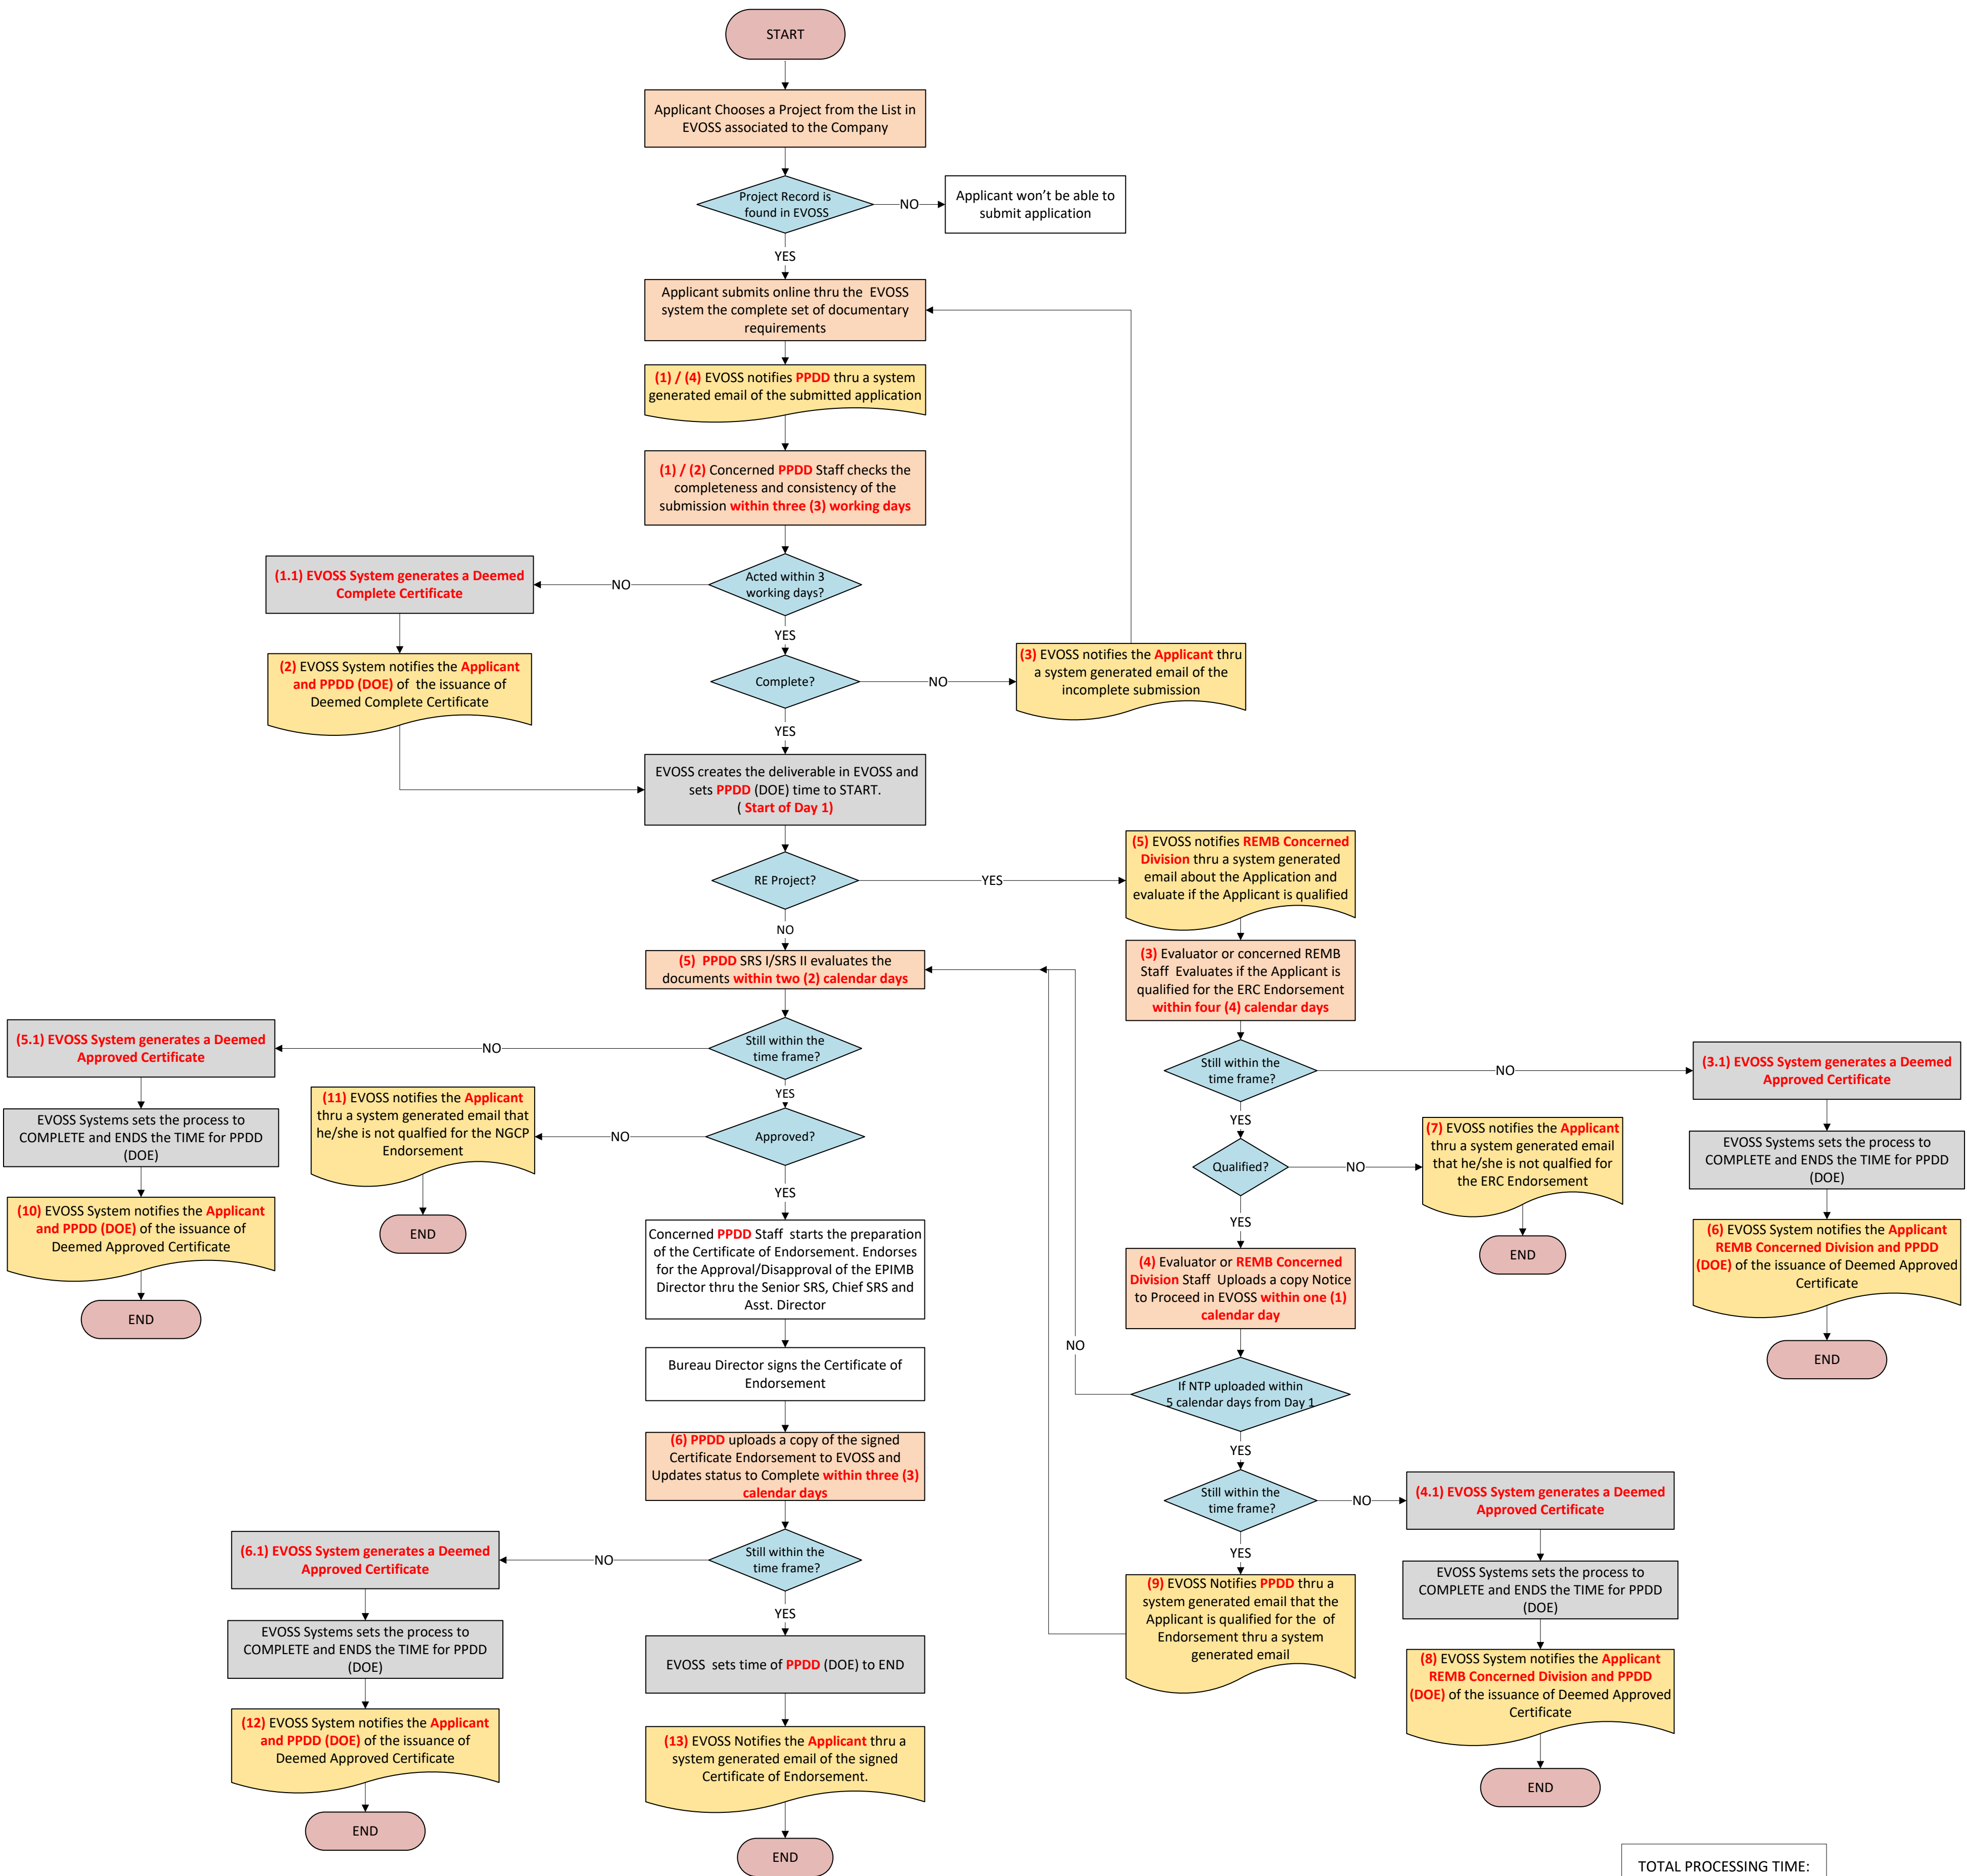

TOTAL PROCESSING TIME:
10 CALENDAR DAYS
(inclusive of the 5 CALENDAR DAYS for the NTP)